



Difference between requirements for reactive power in a traditional and a restructured power system using monte carlo method

Laleh Haddadi¹, Abolfazl Pirayesh Neghab², and Seid Babak Mozafari³



Department of power engineering, Science and Research branch, Islamic Azad University, Tehran

¹ Master student of Science and Research branch, Islamic Azad university , Tehran

l_haddadi90@yahoo.com

² Faculty member of Shahid Beheshti University

ab_pirayesh@yahoo.com

³ Faculty member of Science and Research branch, Islamic Azad university , Tehran

mozafari_babak@yahoo.com

Abstract

Due to importance of requirements of reactive power in a power system, by using probabilistic load flow with Monte Carlo method we can gain the exact value of requirement reactive power of system in a traditional and a restructured power system. In this paper the main object is the examination of effect of random changes in load, generation and price on all requirement reactive power of system and also the amount of reactive power of each bus. Effective parameters in reactive power distribution are determined and an effective probable model for each of parameters is presented. The simulation results are used by network management for reactive power and voltage control service contracts. The results of analysis in two environment (traditional and restructured power system) are shown. In order to arrive to the aim, Monte Carlo method that is quite practical and useful method for engineering problems, and MATLAB software is used, and studies are done on 30 buses IEEE system that is modeled by MATPOWER software.

Keywords—Reactive power, restructured power system, Monte Carolo simulation

1. Introduction

Reactive power supply is essential for reliably operating the electric transmission system. Inadequate reactive power has led to voltage collapses and has been a major cause of several recent major power outages worldwide.

The rules for procuring reactive power can affect whether adequate reactive power supply is available, as well as whether the supply is procured efficiently from the most reliable and lowest- cost sources.

Not only is reactive power necessary to operate the transmission system reliably, but it can also substantially improve the efficiency with which real power is delivered to customers. Increasing reactive power production at certain locations (usually near a load center) can sometimes alleviate transmission constraints and allow cheaper real power to be delivered into a load pocket [1]

In the other hand Estimation of reactive power more than requirement value will cause additional costs and will occupy capacity of reactive power sources that have other capabilities, like generators. Evaluation of requirements of reactive power for system is very important.

In this paper by using probabilistic load flow with Monte Carlo method we gain the exact value of requirement reactive power of system in a traditional and a restructured power system .

Paper is organized as follows: In section 2 we will review Restructured power system, In Section 3 Examine the pool market Probabilistic load flow using Monte Carlo method in Section 4, and in section 5 the results of the case study will be described.

2.Restrictured power system

Power industry are changing and moving in a direction that by allowing producers to competition and market conditions, try to reduce the costs of producing and distributing electricity, eliminate certain inefficiencies, increase customer choice. This evolution towards a competitive electricity market often called deregulation or restructuring and includes below benefits:

1. Providing choice for consumers
2. Creation suitable condition for providing better service
3. Competitive supply of electrical products at different levels and consequently set reasonable prices for consumers
4. Attract investments in the private sector and guidance for public benefit No need for massive public investment
5. Offered products quality enhancement with respect to the competition and...

3. POOL MARKET

In the pool market model, there are two main sides of entities participating in the market, i.e. customer and supplier. The pool operator takes electricity transaction bids and offers from these two entities and dispatches them in an economic manner depending on the price and MW biddings. In general, the customers and suppliers do not directly interact to each other, but only indirectly through the pool operator.[2] In the pool market, participants post selling offers for a certain amount of electrical energy at a specified price and in a period of time. These offers are sorted by price ascending. And produce market supply curve. And also, the market demand curve is obtained from amount and price of customer requests which are arranged descending. Intersection of supply and demand curves is represented market equilibrium.

In order to implement the restructured power system in this paper we use pool market model.

4 .probabilistic load flow using Monte Carlo method

Monte Carlo simulation is a process that occurrence of modes in all its aspects is purely coincidental. In Monte Carlo simulation, a random number generator is used to model the occurrence of events. This behavior is desirable, because By repeating the simulation, a probability distribution of random numbers will be obtained. And the mean, median, variance and statistical parameters will be calculated.[8] In this paper, by using probabilistic load flow and probabilistic optimal load flow production changes , load changes and active and reactive cost changes in a power system are considered. And also Monte Carlo simulation method is used to determine amount of reactive power demand in a power system.

To consider the uncertainty in the power system probabilistic load flow is a proper way that in it uncertainty in the system parameters are considered as random variables. In this paper, using Monte Carlo method, uncertainty of the system production and loads are modeled as random variables And with running the program and probabilistic load flow and probabilistic optimal load flow for about 8000 to 10000 times, probability distribution of parameters of system be obtained and the amount of requirements reactive power of the system in a traditional and restructured power system are obtained. MATLAB software was used to generate normal random numbers and the required random numbers are generated.

Probabilistic load flow using Monte Carlo method is the most comprehensive tool to evaluate different scenarios for uncertainty in a system. In Monte Carlo simulation at first the base network that in it the network structure is characterized by the production of generator and load bus is selected, then to the following and the flowchart as provided in section 6, load flow is done:

1. Using a random normal distribution function a random amount of load for a load bus is selected.
2. The selected bus is modified with the new value selected
3. Using Newton-Raphson load flow network status can be evaluated and the amount of output parameters are characterized.
4. If the stopping criterion is provided by the simulation, the simulation ends, Otherwise, items 1 to 3 are repeated. Stopping criterion can determine the number of iterations for Monte Carlo simulation or the specific coefficient of variation is.[9]

With the finishing Monte Carlo simulation, average value of the output parameters obtained from the following equation can be used as the best estimation:

$$\bar{A} = \frac{1}{N} \sum_{i=1}^N A_i \quad (1)$$

And the variance of output parameters can be obtained from the following equation:

$$V = \frac{1}{N} \sum_{i=1}^N (V_k - \bar{V})^2 \quad (2)$$

Where \bar{M} average output parameters, M_k simulation output parameter at the k th iteration and N is the number of samples tested.

In this paper that the output parameter is the system reactive power, Formulas 1 and 2 are as follows:

$$\bar{Q} = \frac{1}{N} \sum_{i=1}^N Q_i \quad (3)$$

$$V = \frac{1}{N} \sum_{i=1}^N (Q_i - \bar{Q})^2 \quad (4)$$

Where \bar{Q} average reactive power output, Q_i amount of reactive power at the i th iteration and N is the number of samples tested.

5. Case study

The study is done on 30 buses IEEE system, that has 6 generator buses and 24 load buses. It is shown in figure1:

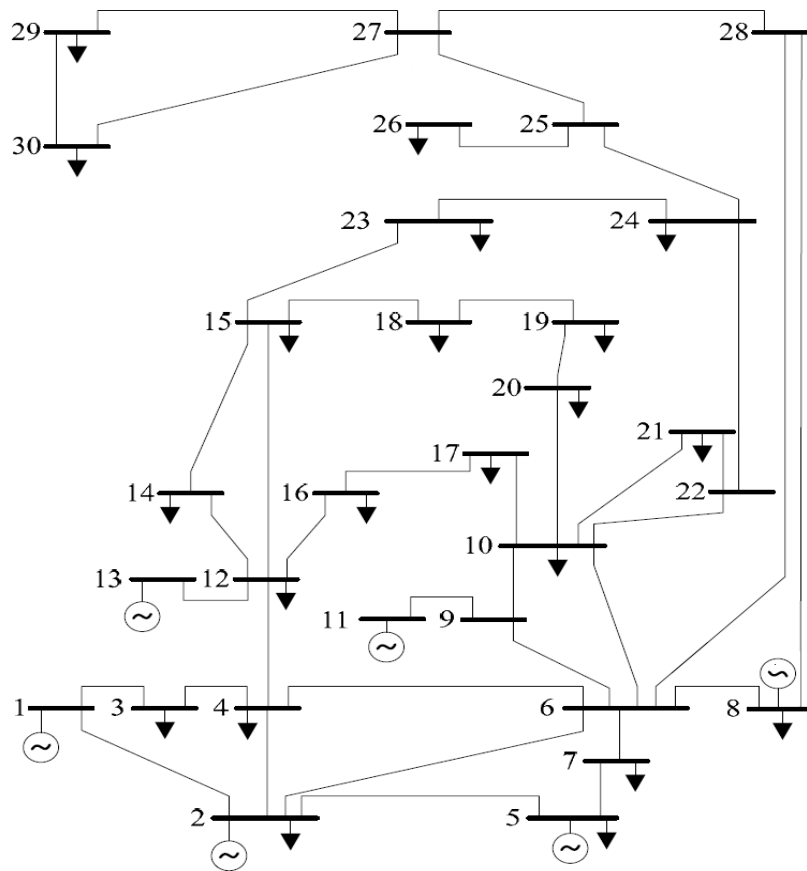


Fig. 1 30 buses network diagram

algorithm based on Monte Carlo simulation is as follows:

1. Count=0
2. generate uncertainty random numbers of production , load, or cost
3. Insert random numbers in the original system and modify system now
4. Do normal load flow or optimal load flow
5. Count+1.
6. If converged, go to step 8.
7. If did not converge, count-1, now and Go to Step 2
8. Do Monte Carlo simulation to saturate system parameters
9. If converged, go to the last step
10. If not converged, go to step 2
11. Compute the average reactive power requirements of the network

To evaluate the system in a traditional system we used newton raphson load flow , with considering different probabilities in load and production and doing 10000 iterations for each mode, the amounts of the requirement reactive power at each bus and all system obtain. Loads of power system are variable and uncertain. Different probability distribution functions may be used to show uncertainty. In this paper we used normal distribution

Figures 2, shows Diagram of Random variation of active load consuming at bus 2.for generating normal random number,” randn “rule in MATLAB software is used.for example in order to generate random numbers of active load consuming at bus 2 below expression is used:

$$x=21.7+ 7.23randn(1) \tag{5}$$

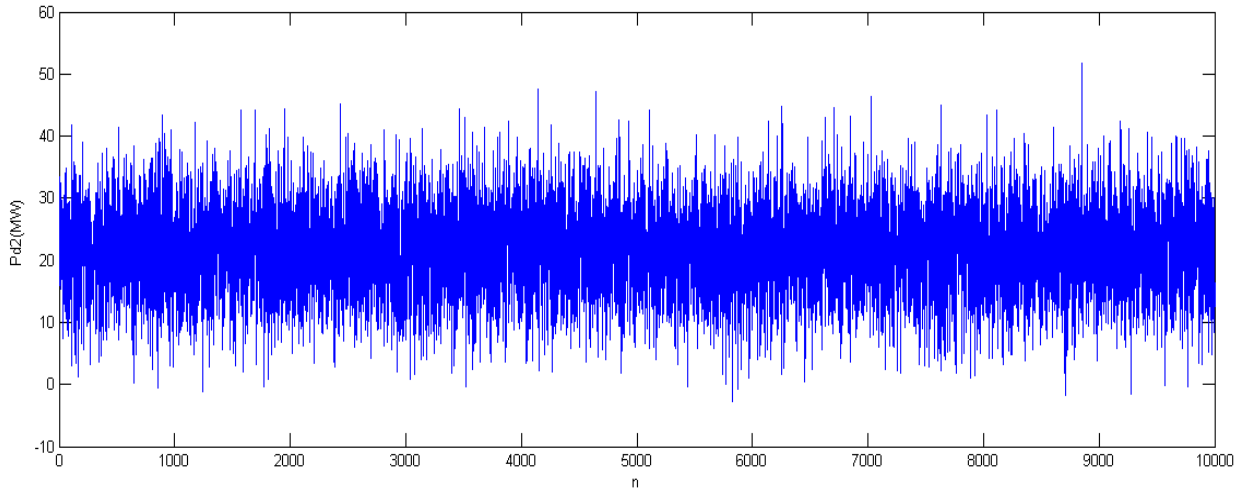
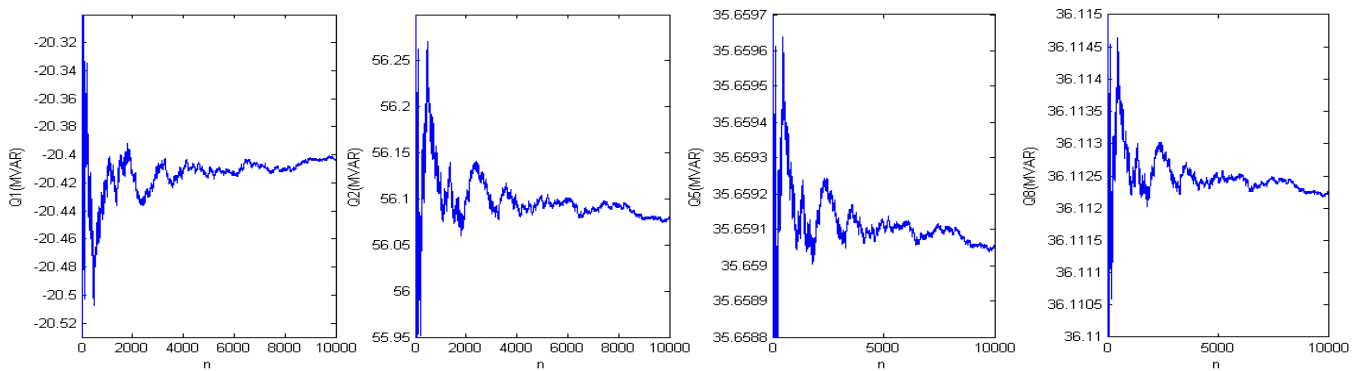


Fig 2. Diagram of random variation of active load consuming at bus 2

To evaluate the system in a restructured system and in a pool market, in the above algorithm, optimal load flow is used instead of the ordinary load flow. And moods of production, load and price changes are considered as a normal random distribution.This time the number of iterations of simulation is 8000 times. .

Figures 3 and 4 are shown examples of the diagrams of mean changes of reactive power generation at bus 1, 2, 5, 8, 11, 13, and the whole system, result of random changes in the parameters. Results of a number of moods are shown in Tables 1 and 2.



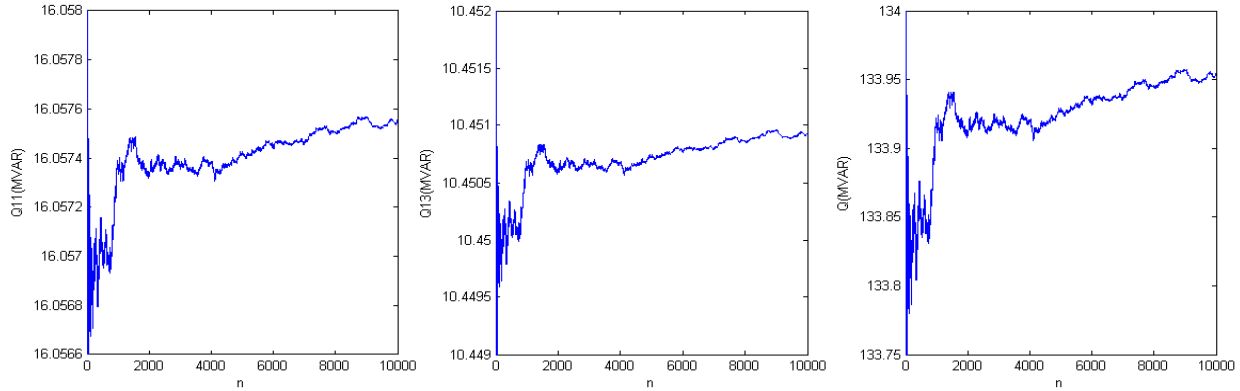


Fig. 3. Diagram of the system reactive power changes in a traditional power system due to random variations in load at bus 2

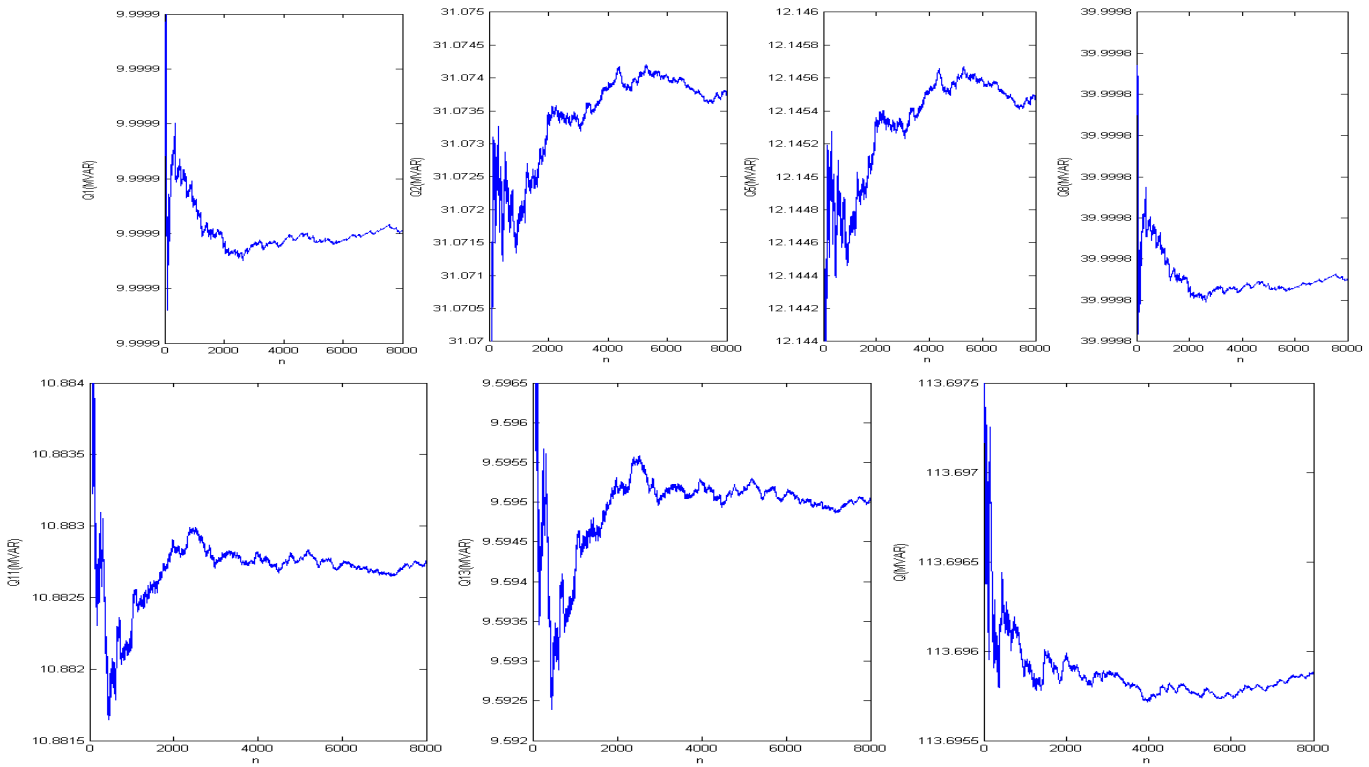


Fig. 4. Diagram of the system reactive power changes in a pool market power system due to random variations in active power cost at bus 8

Cost function is a function of polynomial system (6) considered. Where the coefficients are shown in Appendix Tables 3 and 4.

$$f(p) = C_3 P^3 + C_2 P^2 + C_1 p + C_0 \quad (6)$$

Average of Reactive power random changes / Random States	Bu5	Bu8	Bus13	Total of System
Change of all loads	39.3955	36.5619	10.5669	136.6483
Heavy loading	39.9907	39.8906	11.1937	147.0116

Result of Monte Carlo simulation	35.9175	36.3037	10.4899	134.7411
Optimal load flow with a medium value	35.66	36.11	10.45	133.93

Table 1. The results of the required reactive power in a traditional power system

Average of Reactive power random changes Random States	Bu5	Bu8	Bus13	Total of System
Change of all loads	12.137	39.9999	9.5826	113.8114
Heavy loading	31.4943	40.2744	11.8362	146.2001
Result of Monte Carlo simulation	12.7307	39.9945	9.6846	114.7774
Optimal load flow with a medium value	12.14	40	9.6	113.69

Table 2. The results of the required reactive power in a pool market

6. Conclusion

In this paper by using Monte Carlo simulation, that is a flexible method, we found the exact amount of reactive power is needed for a restructured and a traditional power system. To do this we used the method of probabilistic optimal load flow and considered the uncertainties of production, load and cost and obtained the results of reactive power changes of different buses and also all buses that is the amount of total requirement of reactive power for system. One of states of uncertainty considered is a variable heavy loading of system. that is shown the maximum need of reactive power in a critical condition and without collapse.

Simulation is down on 30 buses IEEE system. The results is shown in section 5.

Result of comparison between restructured and traditional are shown in tables 1 and 2.

APPENDIX

Bus	startup	shutdown	C_2	C_1	C_0
1	0	0	0.038432	20	0
2	0	0	0.25	20	0
5	0	0	0.01	40	0
8	0	0	0.01	40	0
11	0	0	0.01	40	0
13	0	0	0.01	40	0

Table3. Active power generation cost coefficients

Bus	startup	Shutdown	C2	C1	C0
1	0	0	0.02	0	0
2	0	0	0.0175	0	0
5	0	0	0.0625	0	0
8	0	0	0.00834	0	0
11	0	0	0.025	0	0
13	0	0	0.025	0	0

Table4.reactive power generation cost coefficients

REFERENCES

- [1] "Principles for Efficient and Reliable Reactive Power Supply and Consumption" STAFF REPORT Docket No. AD05-1-000 February 4, 2005
- [2] Surachai Chaitusaney, Student, and Bundhit Eua-Arporn, Member, IEEE "Actual Social Welfare Maximization in Pool Market"
- [3] X.Wang , J.R.McDonald "Modern power system planning" IEEE 2002
- [4] Majid Oloomi Buygi, Gerd Balzer, Hasan Modir Shanechi, Mohammad Shahidehpour, "Market-Based Transmission Expansion Planning" IEEE Transaction On Power Systems, VOL. 19, NO. 4 Nov.2004
- [5] Walid El-Khattam, Y.G.Hegazy, M.M.A.Salama "Investigating Distributed Generation Systems Performance Using Monte Carlo Simulation"
- [6] Roy Billinton- Ronald Allen "Reliability Evaluation of Engineering Systems"
- [7] Richard E. Brown "Electric Power Distribution Reliability"
- [8] Christine Roberts "Monte Carlo Methods in Statistics"
- [9] Mehrdad Hojjat, Habib Rajabi Mashhadi "Optimal Dispatch of Power System Restructuring in considering the impact of the independent random variables"
- [10] Hasan Abniki, Hasan Monsef, Mina Jafari Inanlo "Flash estimate voltage using a Monte Carlo method"
- [11] Maryam Ramezani, Mohammad Reza Khalghani, Hamid Falaghi "Probabilistic load flow in the power systems, wind power plants based on classified data"